



LENS REMOVAL - STEP 1

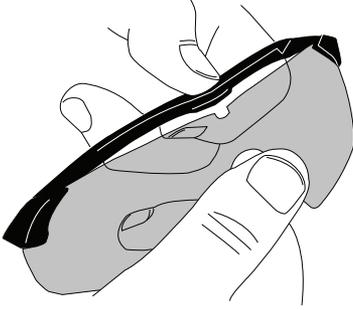


- 1) With one hand firmly grasp the frame directly above the nose piece.
- 2) With the opposite hand grasp the lens.
- 3) Firmly pull on the lens to detach the lens from the center of the frame.

LENS REMOVAL - STEP 2

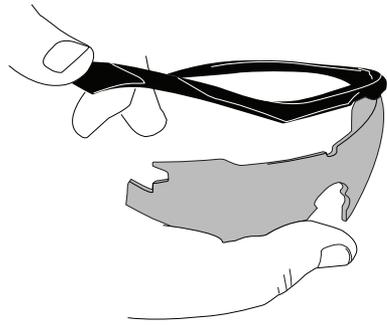

- 4) Detach the outer lens hooks from the frame.


OPTIONAL LEASH CORD

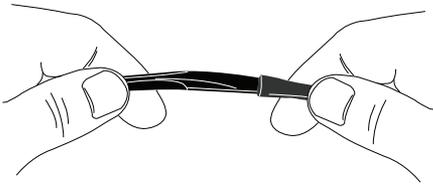

Work the leash cord sleeves over the temple tip until secure.

NOSE PIECE REMOVAL*

- 1) The nose piece and primary lens are interlocking.



- 2) To detach pull a leg of the nose piece. Once the leg is disengaged the nose piece will simply rotate out.



*Should you require corrective lenses, remove the Rx carrier prior to removing the nosepiece. See Rx carrier instruction.

MAINTENANCE: Wiley X lenses are specially coated to offer superior abrasion resistance. Please follow below instructions to prolong the life of your lenses and keep them performing at their best:

- Clean lenses with water only.
- Do not use solvents or special cleaners.
- Use micro-fiber cleaning cloth provided to gently wipe clean.
- Never use paper products to clean and avoid wiping lens surface when dry and/or dirty as this may potentially scratch the lens.

WARNING: Wiley X brand eyewear is tested tough. However, impact resistant eyewear is not unbreakable and does not provide unlimited eye protection under all circumstances and conditions. Misused, abused, scratched and/or damaged eyewear can reduce impact protection (and void your limited warranty). Dirty and/or wet eyewear can impair vision and reduce safety (resulting in personal injury and/or property damage). Keep your Wiley X eyewear clean with water only. Do not use solvents or abrasives as it could scratch or damage the product reducing its effectiveness. Store your Wiley X eyewear in the protective case provided to prolong the life of the lenses. Most of all, take all appropriate precautions when wearing your Wiley X eyewear during hazardous and/or dangerous activities and conditions. Wiley X, Inc. is not responsible for personal injury, property damage or losses incurred while using Wiley X brand products.




WX VAPOR INSTRUCTIONS

 **WILEY X INC. 1.800.776.7842 // 925.243.9810 // WILEYX.COM**
7800 PATTERSON PASS ROAD, LIVERMORE CA 94550 USA
WILEY X EUROPE LLC: +45 96 93 00 45 // WILEYX.EU
SØNDERGADE 8-10 7570 VEMB DENMARK **ERX-ICVPR (1)**


COPYRIGHT © 2014 WILEY X, INC. ALL RIGHTS RESERVED.
WILEY X, WX, BLACK OPS, logos, tag lines and product names are trademarks or registered trademarks (marcas registradas) of Wiley X, Inc. in the U.S. and other countries. Logos © 2007-2014 Wiley X, Inc. All rights reserved.

LENS INSTALLATION - STEP 1

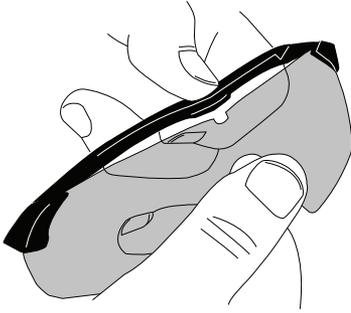


1] Attach outer corners of lens into frame.

LENS INSTALLATION - STEP 2

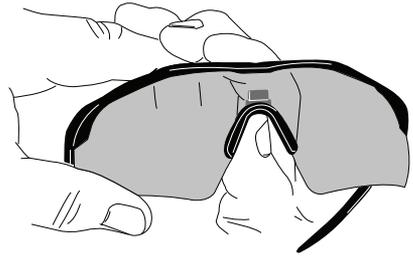


2] Align center lens slot into center catch of the frame.
3] Squeeze the lens and frame together.

NOSE PIECE INSTALLATION* - STEP 1

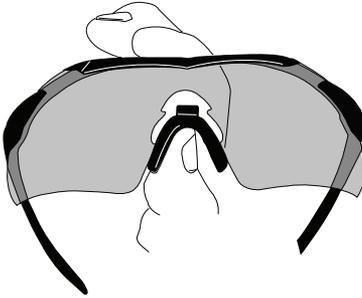

1] Align grooves of nose piece into the lens.

NOSE PIECE INSTALLATION - STEP 2

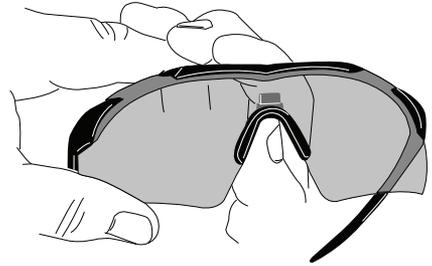


2] Position hand as pictured and squeeze together until the nose piece completely seats into the lens.

**Should you require corrective lenses, remove the Rx carrier prior to removing the nosepiece. See Rx carrier instruction.*

RX CARRIER INSTRUCTION

INSTALLING THE CORRECTIVE LENS CARRIER

1] Remove the nose piece from the lens as directed in "nose piece removal."




2] Fully insert the post at the top of the nosepiece into the slot of the rx carrier.

3] Install the nose piece into the lens.



REMOVING THE CORRECTIVE LENS CARRIER

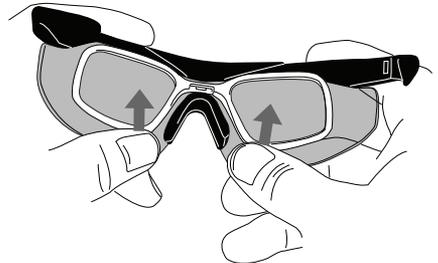

1] Place hands as pictured.
2] Gently push up with thumbs until Rx carrier disengages from post.